

**PATIO COVER REQUIREMENTS:** 

### MINIMUM STANDARDS FOR RESIDENTIAL PATIO COVERS


Building Division Supervisor Contracted Services Provided by EsGil Corporation (760) 633-2719 buildingsupervisor@encinitasc a.gov

Building Permits P: (760) 633-2730

building@encinitasca.gov

This standard plan complies with fire-resistive construction requirements for Wildland-Urban Interface (WUI) areas

	Patio covers are one-story structures not exceeding 12 feet in height.  Patio covers shall be used for recreational, outdoor living purposes and not as carports, garages, storage rooms or habitable rooms.  Openings shall be permitted to be enclosed with insect screening.  Enclosure walls shall be permitted to be any configuration, provided the open area of the longer wall and one additional wall is equal to at least 65% of the area below a minimum of 6'-8" of each wall, measured from the floor.  Exterior openings required for light and ventilation shall be permitted to open into a patio structure. However, the patio structure shall be completely unenclosed if such openings are serving as emergency egress or rescue openings from sleeping rooms.  Where the patio cover is connected to an existing building there shall be no window, door, or other openings under the patio cover that are greater than 6 feet wide.  The California Building Code requires that the minimum distance from property line to the proposed patio cover shall be 5 feet. Please see the Zoning Ordinance for zoning requirements.
CAR	PORT REQUIREMENTS:
	<ul> <li>Carports shall be entirely open on two or more sides.</li> <li>Where the carport is connected to an existing building there shall be no window, door, or other openings under the carport that are greater than 6 feet wide.</li> <li>Minimum distance from property line to proposed carport shall be 5 feet.</li> </ul>
GEN	ERAL REQUIREMENTS:
	No modification shall be made to these plans unless approval is obtained.  The use of this standard plan is limited to residential occupancies and accessory structures.  This plan must be accompanied by a plot plan prepared in compliance with Plot Plan Minimum.  All work shall comply with the 2019 <i>California Building Code</i> and/or 2019 <i>California Residential Code</i> .
	<ul> <li>Outdoor lighting fixtures shall be high-efficacy luminaires or a photo-control/motion-sensor combination</li> <li>Framing members shall be Douglas Fir-Larch #2 or better.</li> <li>Fasteners for preservative treated wood shall be of hot dipped zinc-coated galvanized steel, stainless steel, silicon bronze, or copper.</li> <li>The horizontal distance from the bottom leading edge of footings to daylight shall be 7'-0" minimum.</li> <li>Concrete mix for footings shall have a minimum compressive strength of f'<sub>c</sub> = 2,500 psi.</li> </ul>

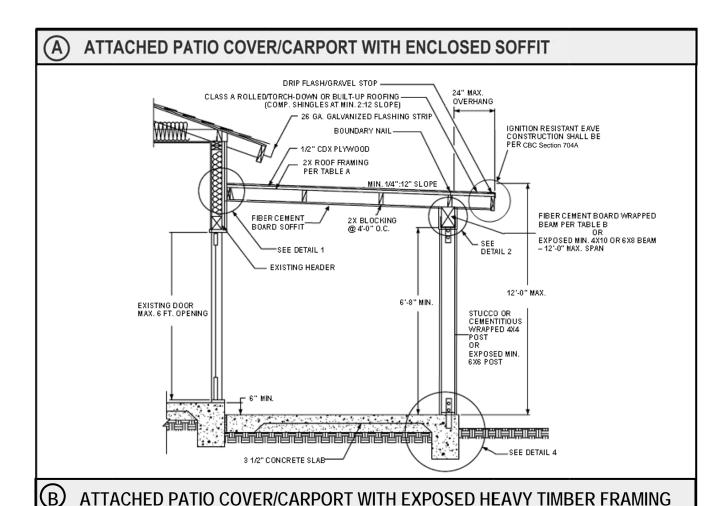


#### DRIP FLASH/GRAVEL STOP CLASS A ROLLED/TORCH-DOWN OR BUILT-UP ROOFING 24" MAX, OVERHANG 26 GA. GALVANIZED FLASHING STRIF **WWW BOUNDARY NAIL** MIN. 2X T&G MIN. 4X6 RAFTERS @ 32" O.C. MAX. MIN. 3X FASCIA MAX, SPAN 12 FT. MIN. 1/4":12" SLOPE MIN. 3X BLOCKING @ 4'-0" O.C. MIN. 4X10 OR 6X8 BEAM -12'-0" MAX. SPAN SEE DETAIL 1 DETAIL 2 EXISTING HEADER 12'-0" MAX. 61-811 MIN. EXISTING DOOR MAX. 6 FT. OPENING MIN. 6X6 POST ⊏ 6" MIN.

3 1/2" CONCRETE SLAB

-SEE DETAIL 4

## (C) DETACHED PATIO COVER/CARPORT WITH EXPOSED HEAVY TIMBER FRAMING

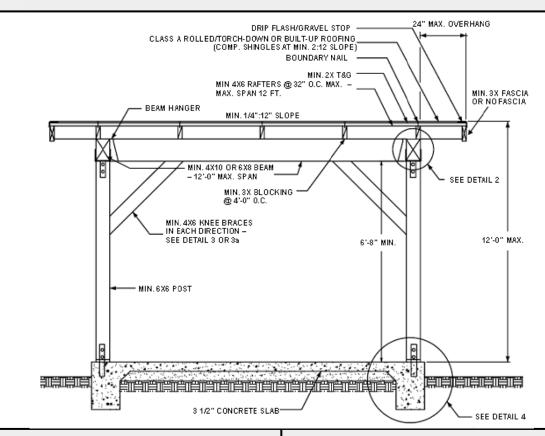

#### TABLE A: MINIMUM RAFTER SIZES\*

Rafter Span	Rafter S	Rafter Spacing (center-to-center)			
(Ft.)	12"	16"	24"		
6	2x4	2x4	2x4		
8	2x4	2x4	2x6		
10	2x6	2x6	2x6		
12	2x6	2x6	2x8		

\*Rafters of less than 4x6 nominal size shall be approved fire-retardant treated lumber or protected by fiber cement board.


#### TABLE B: MINIMUM BEAM SIZES\*


Post	Rafter Span			
Spacing	6	8	10	12
(Ft.)	Ft.	Ft.	Ft.	Ft.
4	4x4	4x4	4x4	4x4
6	4x4	4x4	4x6	4x6
8	4x6	4x6	4x6	4x8
10	4x8	4x8	4x8	4x8
12	4x8	4x10	4x10	4x10

<sup>\*</sup> Beams of less than 4x10 or 6x8 nominal size shall be approved fire-retardant treated lumber or protected by fiber cement board.

#### TABLE C: FOOTING WIDTH "W"


Post Spacing	Rafter Span (Ft.)			
(Ft.)	6	8	10	12
4	12"	12"	12"	12"
6	12"	12"	12"	14"
8	12"	14"	14"	16"
10	14"	16″	16"	18″
12	16"	16"	18"	18"

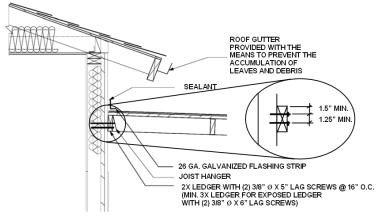


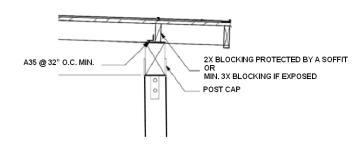


# **LEDGER AT EXISTING WALL**


# **BEAM TO POST CONNECTION** PROVIDE BRACING AT ALL POSTS PER DETAILS 3 & 3A









KNEE-BRACE @ CORNER KNEE-BRACE



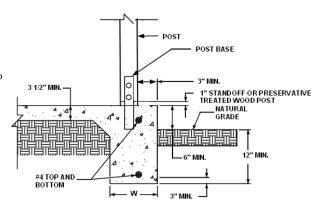

**PIER FOOTING** SQUARE "W"X"W" (SEE TABLE C)

**ALTERNATE CONTINUOUS FOOTING** (SEE TABLE C)



**OPTIONAL TRELLIS DETAIL** PROVIDE BRACING AT ALL POSTS PER DETAILS 3 & 3A